

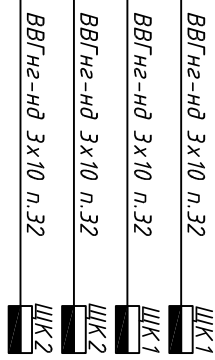



(БУ ліфта 1)				
СЛ1	10.00	0.65	23.37	75
750	0.98	ВВГнг-нд 5х10 п.32		

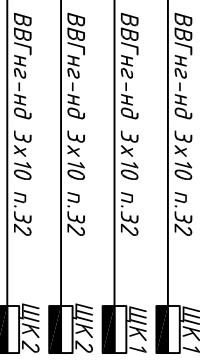

(БУ ліфта 2)				
СЛ2	10.00	0.65	23.37	75
750	0.98	ВВГнг-нд 5х10 п.32		



СЛ1	10.00	0.65	23.37	75
750	0.98	ВВГнг-нд 5х10 п.32		

С1	86.00	0.98	133.33	70
6020	0.83	5хПВнг-нд(1х95)п.63		

резерв

резерв


С2	97.76	0.98	151.56	70
6843	1.05	5хПВнг-нд(1х85)п.63		

резерв



резерв



ВВІд №1:
Рроз = 93 кВт
Iроз = 146 А
cosφ = 0.97

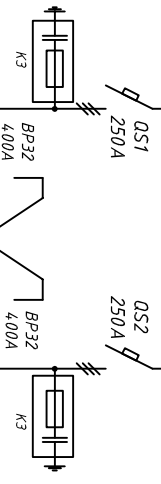

ВВІд №2:
Рроз = 116 кВт
Iроз = 181 А
cosφ = 0.97

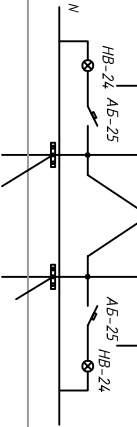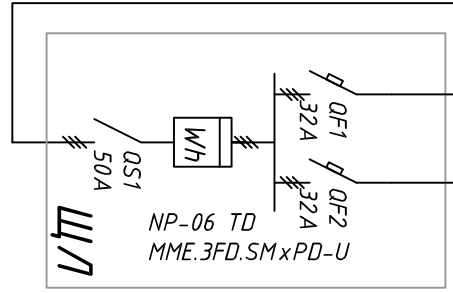

ВРП

ВВГнг 5х25 п.32 (розподільний)
ВВГнг 5х25 п.32 (розподільний)